


2.4.2. (continued)

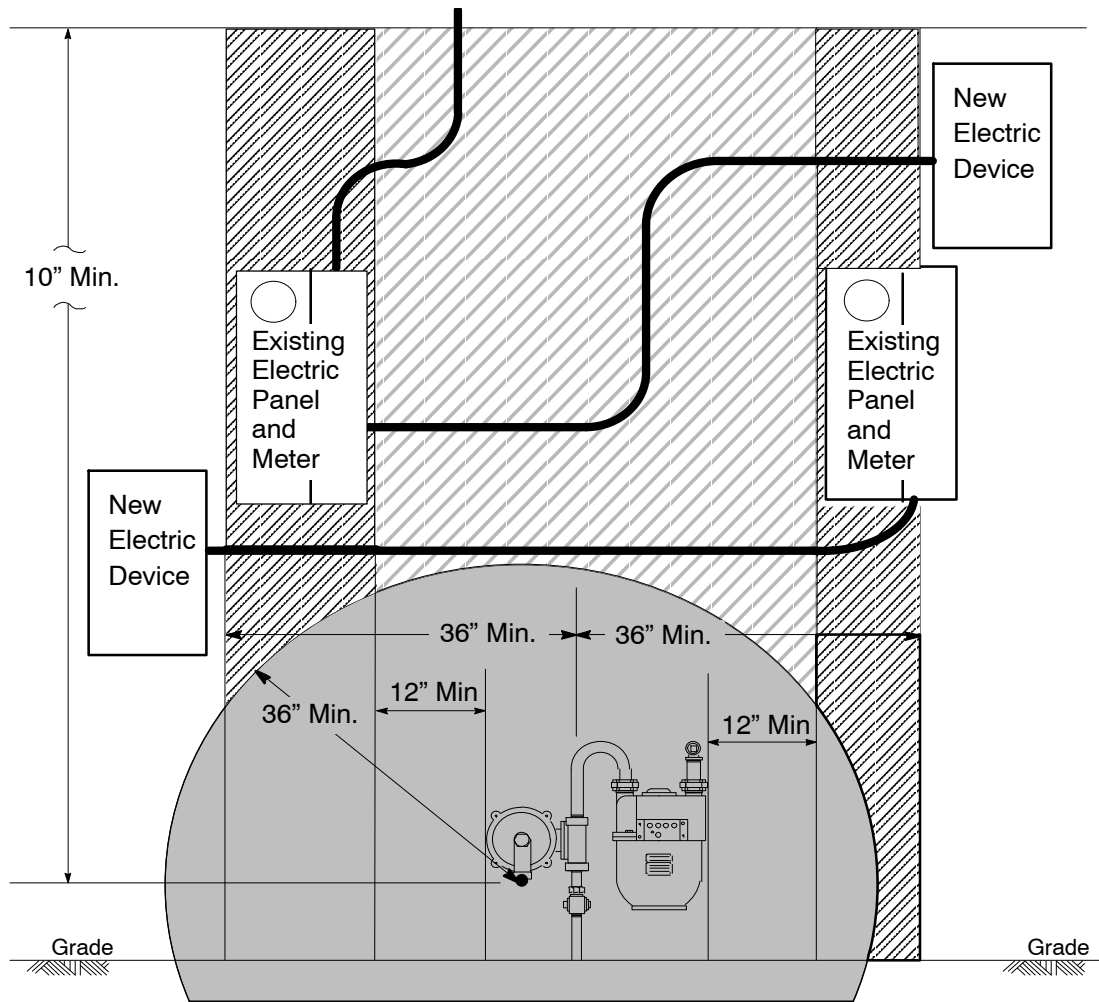

LEGEND

- Regulator Vent Opening
- New Conduit Without Fittings, Couplings, or Joints Except Connection to Panel
- ▨ No Existing Electric Meter/Panel and No New Electric Devices (See Notes 1 and 2)
- No Electrical, No Conduit, No Source of Ignition, No Meter/Panel, and No New Grounding Wires or Clamps
- ▨ No New Electric Devices. Only Electric Panel Upgrades and Like-for-Like Panel Replacements are Allowed.

**Figure 2-22
Clearance Requirements for an Existing Electric Meter/Panel**

Notes in Reference to Figure 2-22:

1. This includes electric meters and panels in cabinets.
2. Junction boxes or other electrical enclosures **must not** be installed to replace the existing electric meter panel.